
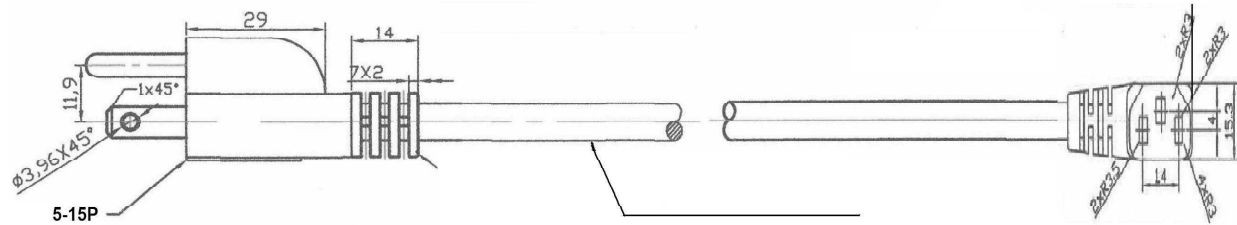



NOTE: ALL MATERIAL COMPLIANT ROHS STANDARD

REVISION INFORMATION

Rev.	Rev. Date	Modified By	Brief Description
	2016-02-18	Zhang	Add cable insulated specification

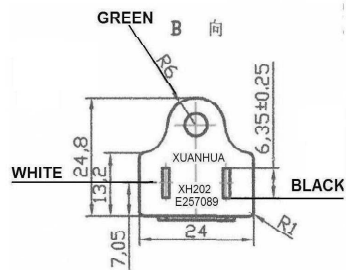

UL c(UL) SVT 3C 18AWG(0.824mm²) 60C VW-1
300V E313867 100030-765 FT1 NINGBO XUANHUA

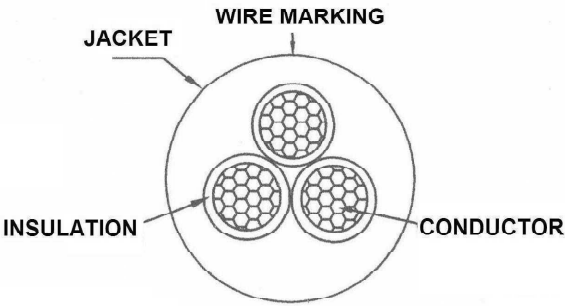

Item No	Length (ft)	T (inches)
210142BK	1	±0.79
210143BK	3	±0.79
210144BK	6	±0.79
210145BK	10	±0.79

CONDUCTOR	INSULATION		JACKET		OVERALL DIA.
AWG	Min Thick	Diameter	Min Thick	Avg Thick	
18AWG 41/0.16	0.33	2.0±0.1	0.61mm	0.76mm	6.2±0.15mm

NOTE: If the conductors O.D is go beyond the scope, the resistance of conductor is standard then.

NO.	PART NAME	SPECIFICATION DESCRIPTION	QTY	UNIT
③				
②				
①				

My Cable Mart

DRAWN BY WANG	DATE: 2016-02-18	DESCRIPTION: XH202 + C13 Right Angle SVT 16/3
CHECKED BY ZHANG	SHEET 1 of 1	ITEM NO.
APPROVED BY	SCALE 1:1	REV. 00 UNIT: mm